


acs243


Sample Name **acs243**
Date collected **2015-07-22**

Pulse sequence **PROTON**
Solvent **cdcl3**

Temperature **25**
Spectrometer **chpc-nmr500a-vnmrs500**

Study owner **acs34**
Operator **acs34**

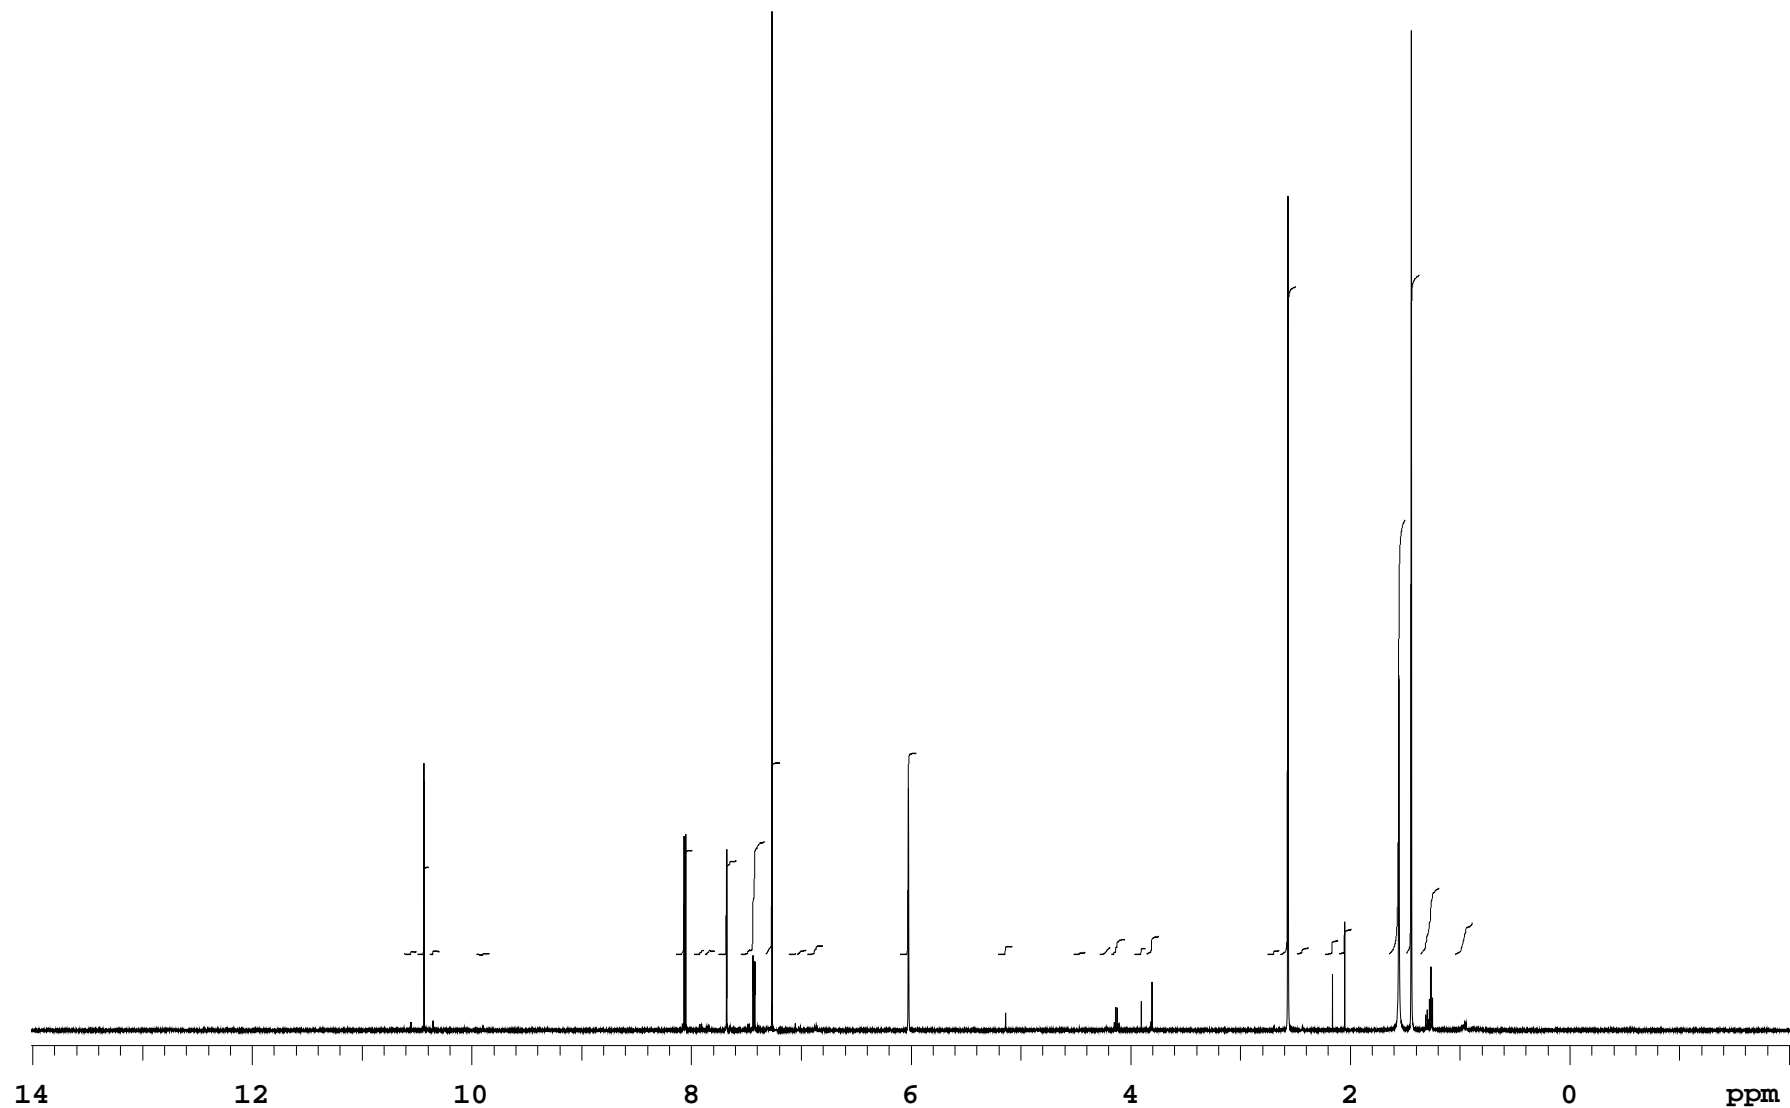

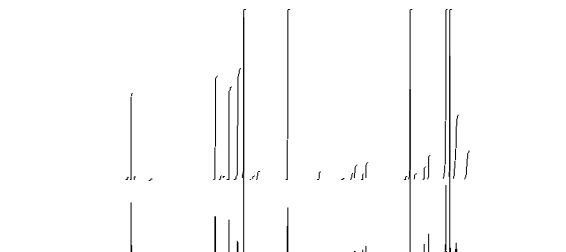

SAMPLE		wet	n
date Jul 22 2015		SPECIAL	
solvent cdcl3			
file /home/bath/vnmrsys		temp	25.0
/data/acs34/acs243_20150		gain	50
722_01/PROTON_01.fid		spin	20
		hst	0.008
		pw90	7.700
		alfa	10.000
ACQUISITION			
sw	8012.8	FLAGS	
at	2.045	il	n
np	32768	in	n
fb	4000	dp	y
bs	32	hs	nn
d1	1.000	PROCESSING	
nt	8		
ct	8		
TRANSMITTER		fn	65536
tn	H1	DISPLAY	
sfrq	500.061	sp	-1005.8
tof	500.1	wp	8012.6
tpwr	60	rfl	1006.0
pw	3.850	rfp	0
DECOUPLER		rp	99.7
dn	C13	lp	0
dof	0	PLOT	
dm	nnn	wc	234
decwave	W40_OneNMR	sc	8
dpwr	38	vs	45
dmf	32258	th	37
PRESATURATION		ai cdc ph	
satmode	n		

Plotname: PROTON_01_plot01

Data file **/home/bath/vnmrsys/data/acs34/acs243_20150722_01/PROTON_01.fid**

Plot date **2015-07-22**